

ILLEGIB

Approved For Release 2001/06/09 : CIA-RDP78T05439A000500020087-3

Approved For Release 2001/06/09 : CIA-RDP78T05439A000500020087-3

~~SECRET~~

DECLASS REVIEW by NIMA/DOD

IB - 163/65  
3 May 1965  
Copy No. 1

~~MEMORANDUM FOR Chief, Requirements Division ORR~~

25X1A ATTENTION : [REDACTED] R/EP  
THROUGH : Chief, Requirements Branch, Reconnaissance Group, CGS  
FROM : Chief, Photographic Intelligence Division, CIA  
SUBJECT : Cuban Electric Power Plant Graphics  
REFERENCES : (1) ORR Requirement No. C-RR5-82,443  
(2) CIA/PID Project No. 30524-5

1. This memorandum is in response to the above referenced requirement requesting 8" x 10" maximum enlargements of six cuban power plants from recent [REDACTED]

25X1A 2. The following enlargements are included as attachments to this report:

25X1A Figure 1. Mariel Thermal Power Plant, La Boca [REDACTED]  
25X1D 23 01 15N - 82 45 05W  
6X Enlargement [REDACTED]

25X1A Figure 2. Mariel Thermal Power Plant, La Boca [REDACTED]  
25X1D 23 01 15N - 82 45 05W  
6X Enlargement [REDACTED]

25X1A Figure 3. Matanzas Thermal Power Plant and Transformer Station  
25X1D [REDACTED]  
23 04 00N - 81 32 15W  
7X Enlargement [REDACTED]

25X1B Figure 4. [REDACTED]  
25X1D 21 33 20N - 77 14 10W  
6X Enlargement [REDACTED]

25X1A Figure 5. Cienfuegos (O'Bourke) Thermal Power Plant  
25X1D [REDACTED]  
22 09 30N - 80 27 11W  
6X Enlargement [REDACTED]

S-16999

SECRET

SUBJECT: Cuban Electric Power Plant Graphics

25X1A

Figure 6. Santiago Thermal Power Plant Rente

19 59 45N - 75 52 00W

6X Enlargement

25X1D

3. Two enlargements of Mariel Thermal Power Plant, La Boca from missions of different dates are included to satisfy the requirement.

25X1D

4. No power plant or construction activity was observed on Punta Martillo (20 10 30N - 77 25 30W) which was previously incorrectly located at 22 10 15N - 76 25 15W in Memorandum IB 308/64, dated [REDACTED]. An area five miles wide along the coast from Niquero to Manzanillo was also searched for the reported power plant. The only item of significance observed was a disconnected section of a power line which begins one nautical mile west southwest of San Ramon and ends 2.5 nautical miles east of Manzanillo. The alignment of this power line is accurately depicted on U.S. Air Target Chart Series 200 Sheet No. 0586-25HL 3rd Edition, October 1964 (SECRET).


25X1A

5. The photo analyst assigned to this requirement was [REDACTED] who may be contacted on extension 2546 (gray phone 19-57) for additional consultation concerning this memorandum and its attachments. This memorandum and its attachments complete this requirement.

25X1A

ATTACHMENTS:

5 Annotated Photographic Enlargements  
(CIA/PID/IB-P-469/65 thru P-474/65)



SECRET

S-16999

SECRET

IB - 163/65



25X1D

FIGURE 1. MARIEL THERMAL POWER PLANT  
1A BOCA ( [REDACTED] )  
25X1A 23 01 15N - 82 45 05W  
CIA/PID/IB-P-469/65

SECRET

S-16999

SECRET

IB - 163/65



FIGURE 2. MARIEL THERMAL POWER PLANT  
25X1A  
LA BOCA  
23 -1 15N - 82 45 05W  
CIA/PID/IB-P-470/65

SECRET

25X1D

S-16999

SECRET

IB - 163/65

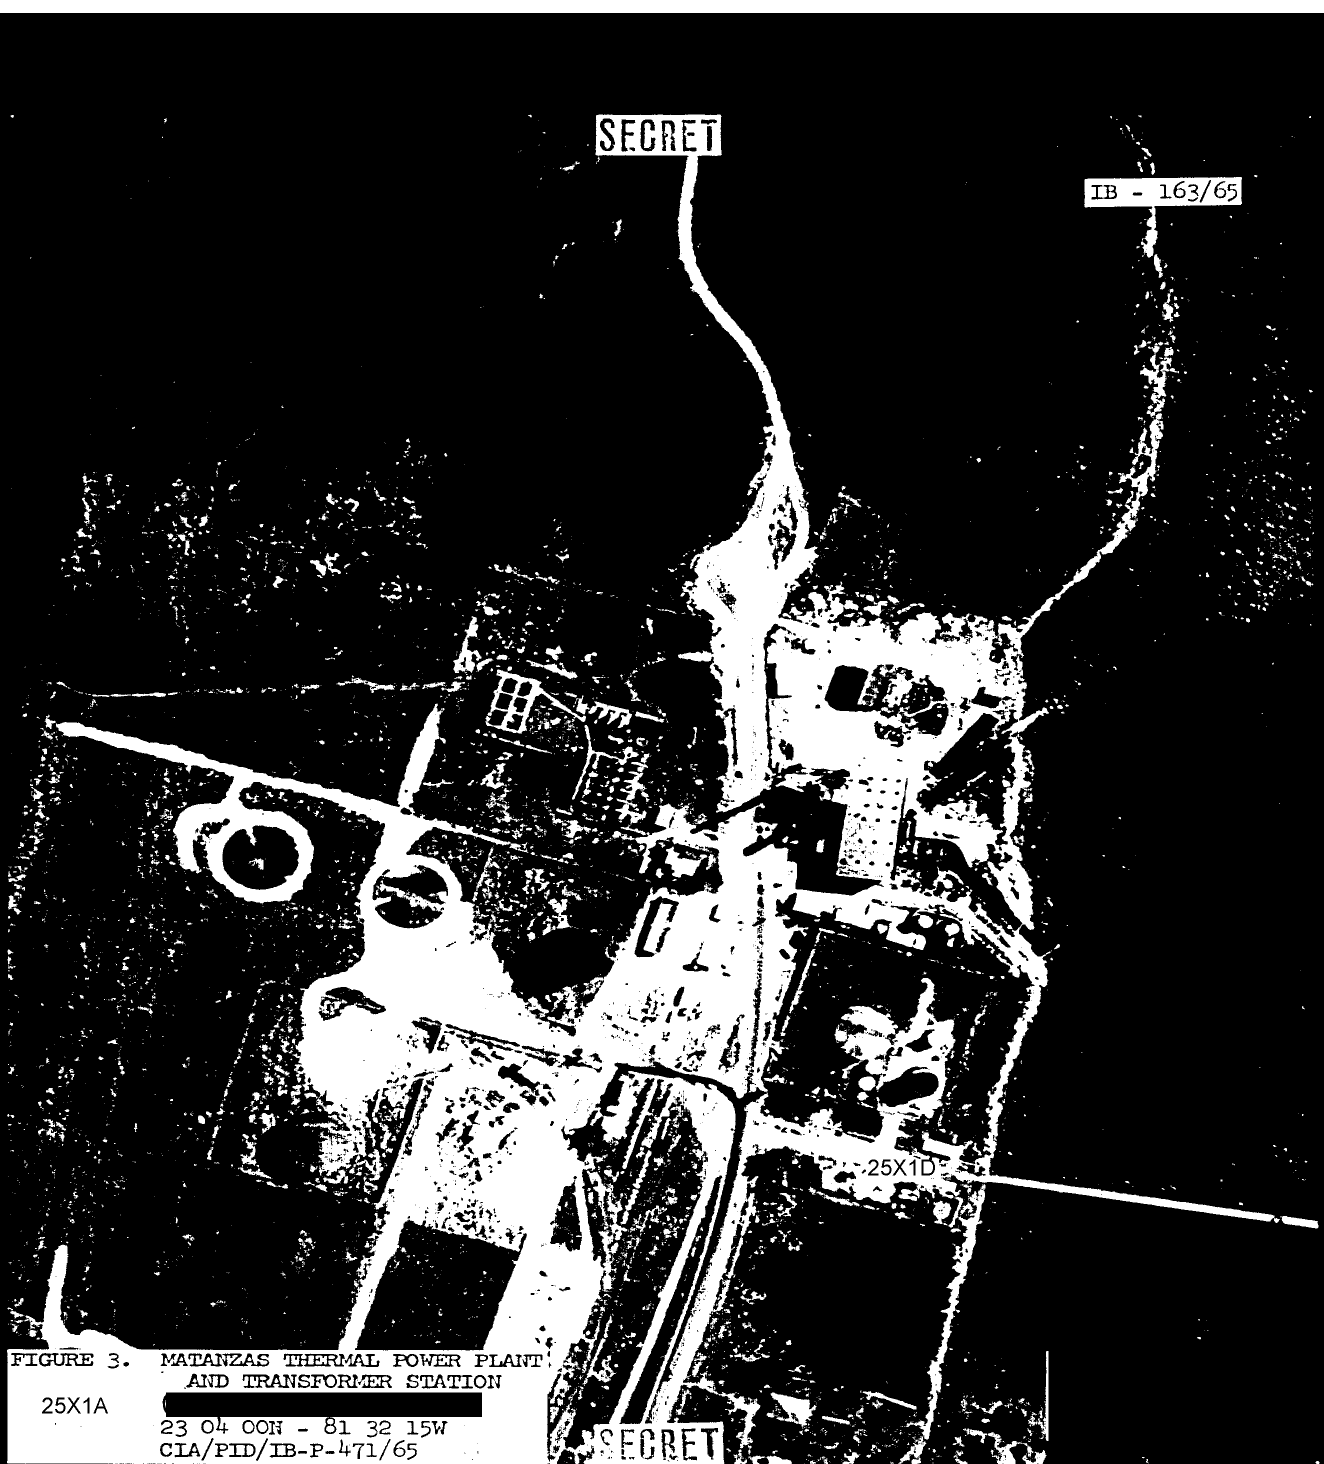


FIGURE 3. MATANZAS THERMAL POWER PLANT  
AND TRANSFORMER STATION

25X1A

23 04 OON - 81 32 15W  
CIA/PID/IB-P-471/65

SECRET

S-16999

25X1B

Approved For Release 2001/06/09 : CIA-RDP78T05439A000500020087-3

Approved For Release 2001/06/09 : CIA-RDP78T05439A000500020087-3



SECRET

IB - 163/65

25X1D

FIGURE 5. CIENFUEGOS THERMAL POWER PLANT  
O'BOURKE [REDACTED]  
25X1A 22 09 30N - 80 27 11W  
CIA/PID/IB-P-473/65

SECRET

S-16999





FIGURE 6: SANTIAGO THERMAL POWER PLANT  
25X1A RENTIE (REDACTED)  
19 59 45N - 75 52 00W  
CIA/PID/IB-P-474/65

SECRET

S-16999